



Reducing the Risk of Ground Water Contamination by Improving Petroleum Product Storage

B.L. Harris, D.W. Hoffman and F.J. Mazac, Jr.*

- 1. Do you store liquid petroleum products closer than 100 feet from your water well?
- 2. Are you planning to build a new petroleum storage tank on your property?
- 3. Do you store petroleum products below ground on your property?
- 4. Does your storage system lack proper spill and overfill protection?
- 5. Do you store petroleum products in an above-ground tank?
- 6. Is your tank more than 20 years old?
- 7. Do you need to become more aware of proper petroleum tank monitoring procedures?
- 8. Do you have any storage tanks that are no longer in use?

If these questions create doubt about the safety of your management practices, this publication will provide helpful information.

^{*}Professor and Extension Soils Specialist; Research Scientist, Texas Agricultural Experiment Station; Extension Associate-Water Quality, The Texas A&M University System.

Petroleum Products Overview

Storing liquid petroleum products, such as motor fuel and heating fuel, above ground or underground presents a potential threat to public health and the environment. Nearly one out of every four underground storage tanks in the United States may now be leaking, according to the U.S. Environmental Protection Agency. If an underground petroleum tank is more than 20 years old, and especially if it is not protected against corrosion, the potential for leaking increases dramatically. Newer tanks and piping can leak, too, especially if they were not installed properly.

Even a small gasoline leak of one drop per second can result in the release of about 400 gallons of gasoline per year. A few quarts of gasoline in the ground water may be enough to severely pollute drinking water. At low levels of contamination, fuel contaminants in water cannot be detected by smell or taste, yet seemingly pure water may be contaminated to the point of affecting human health.

Preventing tank spills and leaks is especially important because gasoline, diesel and fuel oil can move rapidly through surface layers and into ground water. Also, vapors from an underground leak that collect in basements, sumps or other underground structures have the potential to explode.

Petroleum fuels contain a number of potentially toxic compounds, including common solvents such as benzene, toluene and xylene, as well as additives such as ethylene dibromide (EDB) and organic lead compounds. EDB is a carcinogen, a cancer-causing agent, in laboratory animals, and benzene is considered a human carcinogen.

This publication focuses on safe storage of gasoline, diesel, kerosene and liquid heating fuels. It does not apply to liquid propane (LP) gas, since such leaks vaporize quickly and do not threaten ground water. A glossary at the back of this publication explains the terminology used. The following areas are covered:

- 1) Storage tank location
- 2) Tank design and installation
- Monitoring tanks
- Tank closure
- Evaluation table

Storage Tank Location

From a water quality standpoint, one of the most important aspects of your liquid petroleum storage tank location is how close it is to your water well. State well regulations require that petroleum storage tanks be at least 100 feet from a water well. Minimum separation distances regulate only new well installation. Existing wells are required by law only to meet separation requirements in effect at the time of well construction. However, making every effort to meet current regulations whenever possible will further reduce the risk of contamination.

Every site has unique geologic and hydrologic conditions that affect ground water movement. The time it takes petroleum products to reach ground water also will depend upon local soils. The more porous the soil (sands and gravels, for example), the faster the rate of downward movement to ground water. You may choose to locate a new tank more than 100 feet away from a well to provide reasonable assurance that subsurface flow or seepage of contaminated ground water will not reach the well. If possible, the tank should be located downslope from the well. Figure 1 illustrates petroleum product seepage into soils.

If you have an above-ground tank, follow existing regulations for underground storage tanks as a guide. To protect against explosion and fire, do not locate tanks (especially aboveground tanks) closer than 25 feet to existing buildings. Previous regulations for siting aboveground storage tanks were concerned more with the danger of explosion than with the danger of ground water pollution. State agencies have revised above-ground storage tank regulations to better protect ground water. However, always keep in mind the potential for vapors to accumulate in or under nearby storage buildings. These vapors can directly affect human health and are a fire hazard.

Along with maintaining adequate distance from your drinking water well, choose a location for a new tank based on the following considerations:

* **Soil characteristics.** Highly corrosive clays, wet soils and acidic (low pH) soils can significantly increase the rate of corrosion of underground metal tanks and piping. Use clean backfill during installation



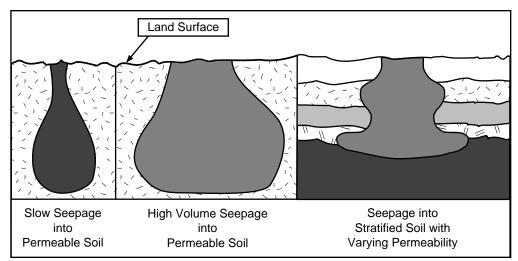


Figure 1. Petroleum product seepage into soils. Source: Underground Tank Corrective Action Technologies, EPA/625/6-87-015, January 1987.

to decrease the negative effects of surrounding soils.

- Soil stability. Assess the suitability of the underlying soil to support both underground and above-ground tanks. At special tank locations, such as hillsides, be sure to properly anchor and hold tanks in place. Regardless of soil conditions, locate aboveground tanks over an impermeable liner made of concrete or one of the newer synthetic fabrics and build a collection basin for spills.
- ★ Damage control. Be sure that pipes cannot twist or break if the tank is bumped or disturbed.
- * Current and previous land use. Sites that contain abandoned pipes and tanks, agricultural drainage tiles or waste materials pose special installation problems. Any metal already in the ground at your chosen site will increase corrosion rates for the new tank.
- * **Traffic.** Assess traffic patterns around the tank. Determine whether the location of the tank or dispenser will block movement of vehicles during refueling or cause special problems if any work needs to be done on the tank. Protect piping from collisions with vehicles.
- ★ Depth to ground water. Floodways or areas where the water table is close to the surface are poor locations for storage tanks. Tanks placed in such areas require

special installation. To reduce pollution potential, an above-ground tank may be preferable to an underground tank in some situations.

Tank Design and Installation

Whenever you install a fuel storage tank, carefully follow the manufacturer's recommended installation practices. Proper installation is one sure way to minimize leaks from the tank or connected piping. Scratches in a metal tank caused by careless installation can increase corrosion and tank deterioration.

Underground Tanks

All new underground petroleum storage tanks and related piping must be constructed of non-metallic materials, such as fiberglass, or have corrosion protection. Methods of corrosion protection include using interior liners and sacrificial anodes which are connected to the tank.

A sacrificial anode is a special material with a greater tendency to corrode than the tank material. The anode will typically protect the tank for up to 30 years. Interior liners are made of non-corrosive synthetic materials and also can be effective in protecting metal tanks.

Texas regulations require that all new underground tanks (other than heating oil tanks for on-site use) have spill and overfill protection. Spill protection typically consists of a catch basin for collecting spills when the tank is filled. Overfill protection is either a warning device, such as, a buzzer or a prevention device such as an automatic shutoff. Spill and overfill protection are important because they can prevent pollution from a number of small releases over a long period of time.

Above-ground Tanks

State regulations for above-ground tank installation seek to reduce the potential for both pollution and fire. Requirements include the following:

- 1) enclosing the tank within a secure 6-foot fence or well-ventilated building constructed of non-combustible material; and
- 2) constructing a fire wall between the fuel dispensing area and the tank.

To decrease pollution potential, place tanks within a secondary containment structure consisting of a dike and a pad. All piping should be above ground within the dike or may go over the dike wall. However, if it goes over the dike wall, it must be placed below the ground and within 10 feet of the dike wall. Aboveground piping must be made of steel and coated to prevent corrosion. Any below-ground piping may be either steel or fiberglass, but the steel piping must be coated and cathodically protected.

Monitoring Tanks

Regulations for new underground tanks require that they have a method of detecting leaks. Select the tank location carefully to ensure that installation is easy and leak detection methods reliable. Test the tank periodically for leaks, and measure the tank inventory on a monthly (or more frequent) basis to help detect leaks before major problems develop.

Since cleanup of gasoline leaks is always costly and often not totally effective, it is important to constantly monitor underground tanks containing petroleum products. If you already have a petroleum storage tank, be especially aware of the age of your tank as well as the need to establish a leak-detecting program. Figure 2 shows how ground water can be contaminated by underground tanks. Since most older tanks are bare steel, they are likely to corrode and leak. If your tank is more than 20 years old or if you do not know its age, make a special effort immediately to determine whether there are leaks.

Even when a tank has been tested and proven tight, existing regulations and good practice require that you have a method for regularly detecting leaks. Some good methods include the following:

- ★ Installing internal or external devices to monitor ground water and vapor, or to automatically gauge tanks.
- ★ Measuring tank inventories regularly. Leakage is apparent when there is any decrease in level over time, without any withdrawal of fuel, or when there is an increase in water in the tank. While inventory measurement will not detect very small leaks, it will at least provide a warning that further investigation may be necessary.
- ★ Using a measuring stick to measure tank liquid level. This method is acceptable, but be sure that the stick does not puncture or damage the bottom of the tank.

The closer the tank is to a water well, the more important it is to have an adequate leak detection system in place.

Tank Closure

Tanks no longer in use can cause problems for owners and operators many years later. They will continue to corrode and, if they still contain gas or oil, will likely contaminate ground water.

Try to determine the location of any unused tanks on your property. Also, try to find out whether the tanks still hold product or have holes. These tanks must be pulled from the ground and disposed of in a landfill or at a scrap dealer.

State law requires that only certified individuals can legally pull a tank. Always notify your local fire department at least 1 month before you have the tank pulled so that they can take precautions to prevent an explosion or other problem. Deaths have occurred because of improper closure.



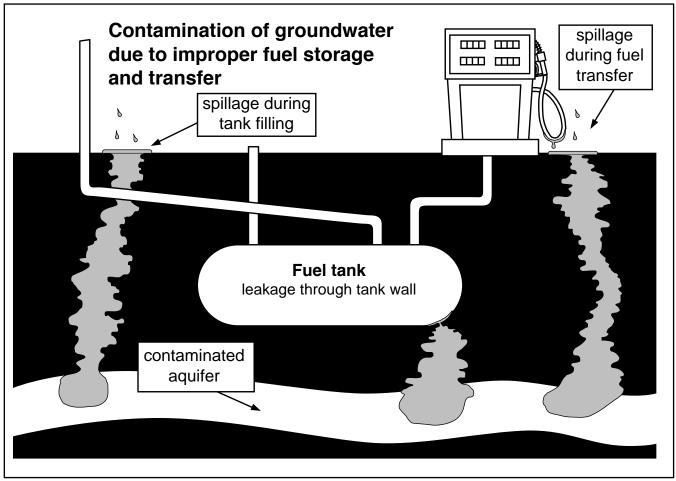


Figure 2. Contamination of groundwater due to improper fuel storage and transfer. Source: Handling and Underground Storage of Fuels, Cooperative Extension Service, Michigan State University, Extension Publication WQ0I, Reprinted, February 1986.

Evaluation Table

The following table can be used to help agricultural producers and rural homeowners determine the risk that drinking water on a given property will be contaminated because of the management practices being used. For each category on the left that is appropriate, read across to the right and circle the statement that best describes conditions on your land. Allows 15 to 30 minutes to complete the table, and skip any categories that do not apply. Note any high risk ratings and take appropriate actions to remedy them. Strive for all low or low-moderate risk ratings.

Petroleum Product Storage: Assessing Drinking Water Contamination Risk						
	Low Risk	Low-Moderate Risk	Moderate-High Risk	High Risk		
Location (all tanks)						
Position of tank in relation to drinking water well	Tank downslope more than 100 feet from well in medium- or fine-textured soils (silt loam, loam, clay loams, silty clay) with low permeability.*	Tank at grade or up- slope more than 100 feet from well in medium- or fine-tex- tured soils (silt loam, loam, clay loams, silty clay) with low permeability.*	Tank downslope more than 100 feet from well in coarse-tex- tured soil (sands, sandy loam) with high permeability.*	Tank at grade or upslope less than 100 feet from well in coarse-textured soil (sand, sandy loams) with high permeability.*		
Tank location and local land use (leakage potential)	Well-drained soils. Water table always beneath tank. Above ground tank more than 50 feet from buildings.	Moderately well- drained soils. Only occasionally high water table.	Located more than 50 feet from buildings. Medium- or fine-tex- tured soils (silt loams, loam, clay loams, silty clay) saturated seasonally.	Located less than 50 feet from build- ings and in areas with fine-textured soils (clay loams, silty clay, clay) often saturated.		
Design and Installation Table (all tanks)						
Type and age of tank/corrosion protection	Synthetic tank or tank with cathodic corro- sion protection.	Steel tank less than 15 years old, coated with paint or asphalt.	Coated steel tank 15 or more years old. Bare steel tank less than 15 years old.	Bare steel tank 15 or more years old.		
Spill and tank over- fill protection	Impermeable catch basin plus automatic shutoff.	Impermeable catch basin plus overfill alarm.	Impermeable catch basin or concrete catch pad.	No protection.		
Piping	Piping protected from rust and corrosion by cathodic protection. Piping isolated from tank and sloped back to tank. Check valve at pump (not at tank).	Piping galvanized but not isolated from tank. Pipe drains back to tank. Check valve at pump.		Piping and tank isolated and of dis- similar materials. Uninsulated pipe bare, cannot drain freely to the tank. All pressure pipe systems.		
Tank installation	Installed by state certified installer.	Installed according to recommendations provided with new tank by seller.	No information on installation.	Installed without backfill, setback, secondary contain- ment, anchors and other protection, OR by untrained individual.		
Design and Installation (above-ground tanks only)						
Tank enclosure	Tank surrounded by 6-foot-tall non-com- bustible building or fence with lock. Build- ing well-ventilated. Firewall in place if setbacks do not con- form to code.	Tank surrounded by low fence with lock. Firewall in place if setbacks do not con- form to code.	Tank surrounded by low fence. No lock. No firewall.	No enclosure.		
*See Glossary.						

Petroleum Product Storage: Assessing Drinking Water Contamination Risk						
	Low Risk	Low-Moderate Risk	Moderate-High Risk	High Risk		
Design and Installation (above-ground tanks only) (continued)						
Secondary containment	Tank placed within concrete or synthetic dike with pad able to hold 125% of tank capacity.	Tank placed within dike and pad made of low permeability soils*, able to hold 125% of tank capacity.	Tank placed on pad.	No secondary containment.		
Monitoring (all tanks)						
Tank integrity testing and leak detection monitoring	Regular (monthly) leak monitoring.	Daily inventory con- trol and annual tank tightness testing.	Occasional inventory control and annual tank tightness testing.	No inventory con- trol, testing or moni- toring.		
Tank Closure (underground tanks)						
Unused tank	Tank removed from ground. Excavation checked for evidence of contamination.	Tank filled with inert material and excava- tion checked for evidence of leaking.	Tank removed or filled with inert material. Excavation not check- ed for contamination.	Tank left in ground (illegal after 12 months).		
*See Glossary.			•			

Glossary

- **Cathodic protection:** One of several techniques to prevent corrosion of a metal surface by reversing the electric current that causes corrosion. A tank system can be protected by sacrificial anodes or impressed current (See sacrificial anodes and impressed current.).
- **Certified installer:** A person certified by the state to install and repair petroleum storage tanks.
- **Corrosion:** Deterioration of a metallic material due to a reaction with its environment. Damage to tanks by corrosion is caused when a metal underground tank and its underground surroundings act like a battery. Part of the tank can become negatively charged and another part positively charged. Moisture in the soil provides the connecting link that finally turns on these tank batteries. Then, the negatively charged part of the underground tank system where the current exits from the tank or its piping begins to deteriorate. As electric current passes through this part, the hard metal begins to turn soft, holes form and leaks begin.
- **Corrosion protection:** One method of corrosion protection is cathodic protection. Steel tanks can be protected by coating them with a corrosion-resistant material combined with "cathodic" protection. Steel underground tanks also can be protected from corrosion if they are bonded to a thick layer of noncorrosive material, such as fiberglass-reinforced plastic. Also, the corrosion problem can be entirely avoided by using tanks and piping made completely of noncorrosive material, such as fiberglass.
- **Galvanized:** The result of coating an iron or steel structure with zinc. Galvanized materials do not meet corrosion protection requirements.
- **Impressed current:** This protection system introduces an electric current into the ground through a series of anodes that are not attached to the underground tank. Because the electric current flowing from these anodes to the tank system is greater than the corrosive current attempting to flow from it, the underground tank is protected from corrosion.
- **Interior liner:** A liner for petroleum storage tanks made of noncorrosive synthetic materials that can be effective in protecting metal tanks.



- **Inventory control:** Measuring and comparing the volume of tank contents regularly with product delivery and withdrawal records to help detect leaks before major problems develop.
- Sacrificial anodes: Pieces of metal attached directly to an underground tank that are more electrically active than the steel tank. Because the anodes are more active, electric current runs from the anodes rather than from the tank. The tank becomes the cathode (positive electrode) and is protected from corrosion. The attached anode (negative electrode) is "sacrificed" or consumed in the corrosion process.
- **Secondary containment:** A system such as a sealed basin and dike that will catch and hold the contents of a tank if it leaks or ruptures.
- **Soil permeability:** The quality that enables soil to transmit water, air or other fluids. Slowly permeable soils have fine-textured materials, such as clays, that permit only slow fluid movement. Moderately or highly permeable soils have coarse-textured materials, such as sands, that permit rapid fluid movement.

- **Spill and overfill protection:** Spill protection usually consists of a catch basin for collecting spills when the tank is filled. Overfill protection is a warning device such as a buzzer or a prevention device such as an automatic shutoff. These precautions can prevent a number of small releases over time from polluting ground water.
- **Tank tightness testing:** A procedure for testing a tank's ability to prevent the leaking of any stored substance into the environment, and to prevent ground water from seeping into the tank.

Contacts and References

For additional information contact:

- ★ The Texas Natural Resource Conservation Commission at (512) 239-1000,
- ★ Texas Agricultural Extension Service Water Quality unit (409) 845-0887,
- ★ Texas State Soil and Water Conservation Board, (817) 773-2250.

Internet address: TEX*A*Syst bulletins and links to other water quality sites are contained in a homepage located on the World Wide Web at: http://waterhome.tamu.edu.

TEX*A*Syst is a series of publications to help rural residents assess the risk of ground water pollution, and to describe Best Management Practices (BMPs) that can help protect ground water. The TEX*A*Syst documents were developed from the national Farm*A*Syst ground water protection program. The TEX*A*Syst system is designed to help the user learn more about the environment, existing environmental policies and regulations, and recommended management practices. Thus, the user can voluntarily reduce the pollution risks associated with water wells.

TEX*A* Syst materials were edited by Anna Schuster Kantor, and reviewed by M.C. Dozier and the personnel of the USDA-Natural Resources Conservation Service, U.S. Environmental Protection Agency, Texas Department of Agriculture, Texas Natural Resource Conservation Commission, Texas Water Development Board, Texas State Soil and Water Conservation Board, Texas Water Resources Institute, and Texas Farm Bureau. Editorial and formatting assistance were provided by the Department of Agricultural Communications, The Texas A&M University System.

> The TEX*A*Syst program is sponsored by the U.S. Environmental Protection Agency under Section 319(h) of the Clean Water Act. Funds for this program are administered by the Texas State Soil and Water Conservation Board's Agricultural/Silvicultural Nonpoint Source Management Program.

Produced by AgriLife Communications and Marketing, The Texas A&M University System Extension publications can be found on the Web at: http://AgriLifeBookstore.org. Visit Texas AgriLife Extension Service at http://AgriLifeExtension.tamu.edu.

Educational programs of the Texas AgriLife Extension Service are open to all people without regard to race, color, sex, disability, religion, age, or national origin.

Issued in furtherance of Cooperative Extension Work in Agriculture and Home Economics, Acts of Congress of May 8, 1914, as amended, and June 30, 1914, in cooperation with the United States Department of Agriculture. Zerle L. Carpenter, Director, Texas Cooperative Extension, The Texas A&M University System.